
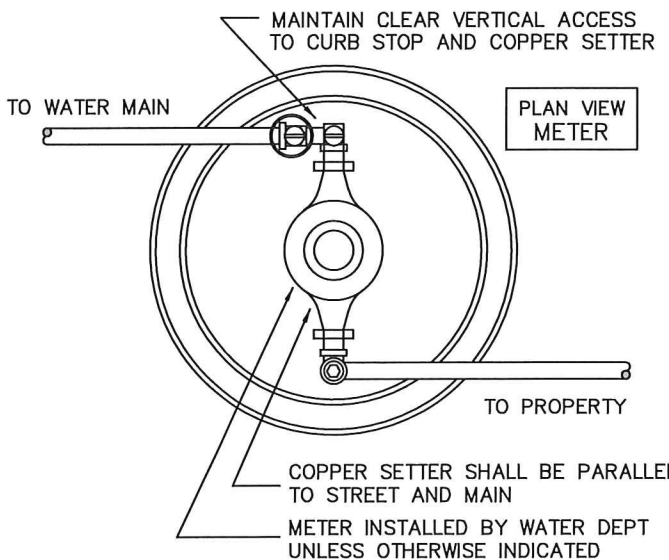


TYPICAL WATER METER LOCATION

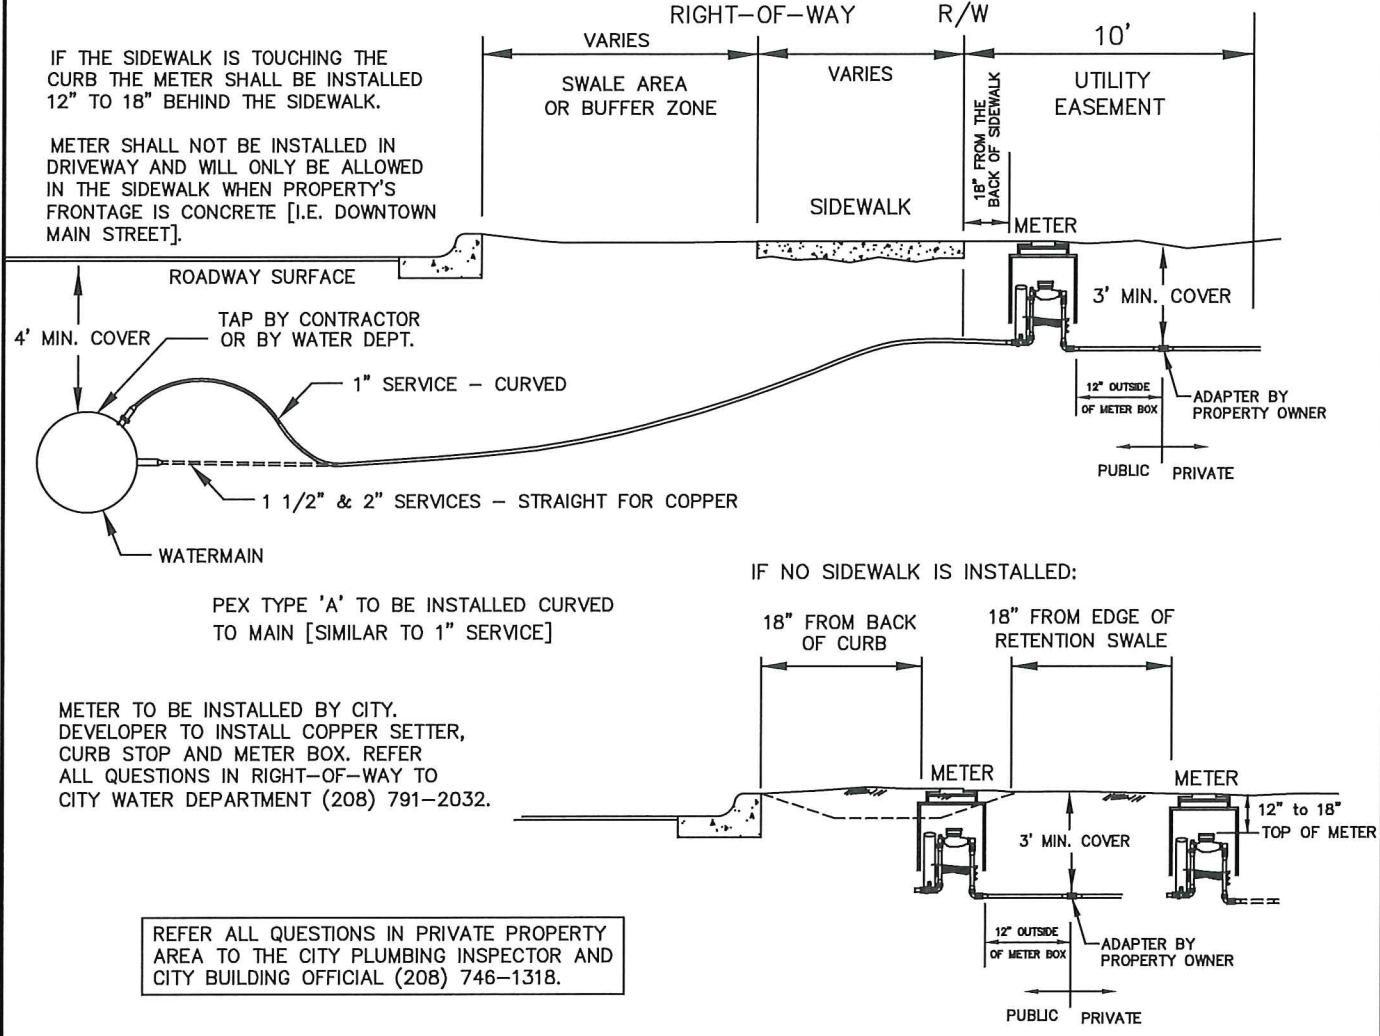

- GENERAL NOTES:
1. WATER SERVICE LINES SHALL HAVE A MINIMUM COVER OF (3) THREE FEET MEASURED FROM THE FINISHED GROUND SURFACE.
 2. SERVICE LINE SHALL BE BACKFILLED AND BEDDED WITH 3" OF SAND OR SOIL FREE OF ORGANIC MATERIAL, ROCK OR OTHER MATERIAL THAT COULD DAMAGE SERVICE LINE.
 3. THE TOP OF THE METER SHALL BE 12" TO 18" DEEP.

SHEET 2 OF 2

CITY OF LEWISTON, IDAHO
PUBLIC WORKS DEPARTMENT

**TYPICAL WATER METER or
UTILITY MARKER LOCATION**

APPROVED FOR PUBLICATION <i>Shawn Stubbins</i> 3/17/15 City Engineer	DWG. NO. 4-5
--	------------------------